


Model	Size	L1	W1	H1	Wt. (Lbs)
DDBP3	3"	9'-0"	5'-0"	5'-6"	16,000
DDBP4	4"	9'-0"	5'-0"	5'-6"	16,000
DDBP6	6"	9'-0"	5'-0"	5'-6"	16,000
DDBP8	8"	9'-0"	5'-0"	6'-6"	18,000
DDBP10	10"	9'-0"	5'-0"	7'-0"	19,000

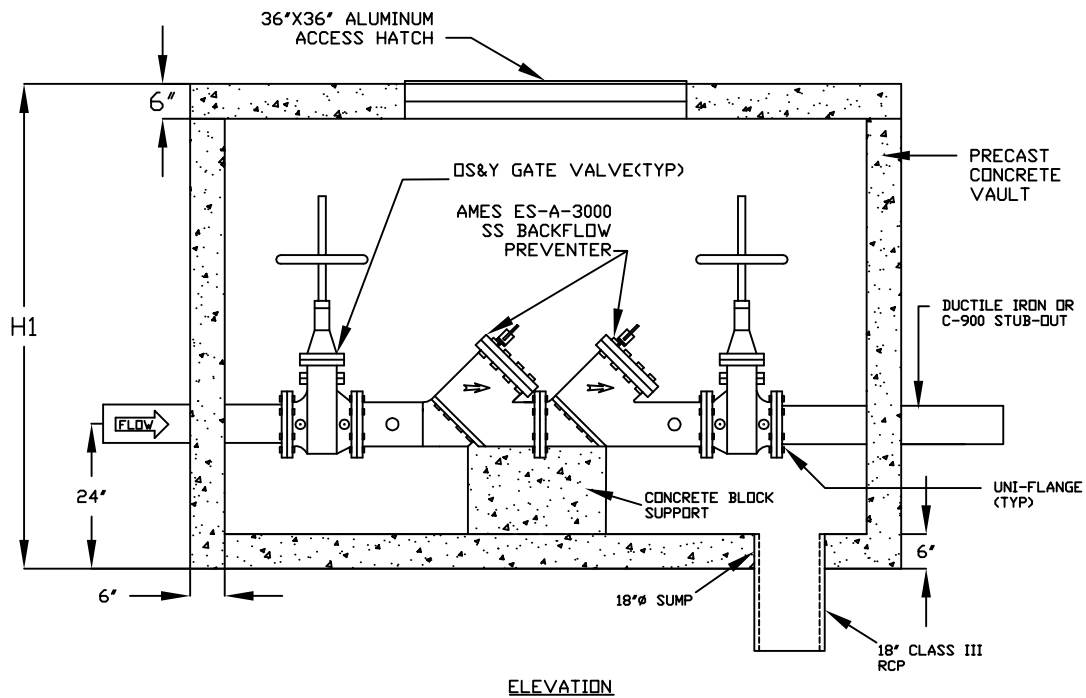

Description

Includes Certified Double Check Detector Assembly with 3/4\"/>

Completely Assembled and Installed in Precast Concrete Vault w/ Galvanized Steel Cover or Aluminum Hatchway.

Specifications

- CONCRETE: CLASS 1 CONCRETE WITH DESIGN STRENGTH OF 5000 PSI AT 28 DAYS. UNIT IS OF MONOLITHIC CONSTRUCTION AT FLOOR AND FIRST STAGE OF WALL WITH SECTIONAL RISER TO REQUIRED DEPTH.
- REINFORCEMENT: GRADE 60 REINFORCED. STEEL REBAR CONFORMING TO ASTM A615 IN REQUIRED CENTERS OR EQUAL.
- HATCHWAY: 1/4\"/>

The Turner Co.

DRAWN BY: DJH	JOB NO:	DATE: 11/23/09
CUSTOMER & PRODUCT DOUBLE DETECTOR BACKFLOW PREVENTER		

JOB NAME
CITY OF IRVING